

TABLE 4-2

PRIORITY RANKING BASED ON WET WEATHER I/I

FLOWMETER No.	WET WEATHER I/I (GPD/IN-MI)				AVERAGE	RANKING
	10/23/ TO 10/24/09	10/28/09	10/31/09	11/19/ TO 11/20/09		
1 ⁽¹⁾	-	-	-	-	-	-
2	10,736	11,717	12,376	9,273	11,026	3
3	9,855	8,185	9,506	10,145	9,423	4
4				3,450	3,450	16
5	4,509	4,430	9,209	11,005	7,288	9
6 ⁽²⁾	-	-	-	-	-	-
7	2,561	6,381	7,515	11,199	6,914	10
8	3,339	6,044	5,253	10,087	6,181	12
9		3,924	831	8,526	4,427	15
10	8,500	7,377	7,129	11,779	8,696	5
11	5,784	5,959	5,944	12,753	7,610	7
12	-	3,102	3,846	6,424	3,343	17
13	6,568	6,250	5,605	11,050	7,368	8
14	4,323	4,214	2,875	11,037	5,612	14
15	35,704	22,032	38,168	95,678	47,896	1
16	4,095	3,708	2,175	1,445	2,856	18
17	4,299	4,926	5,769	9,636	6,158	13
18	5,338	14,935	15,062	11,662	11,749	2
19 ⁽³⁾	-	-	-	-	-	-
20	6,649		4,918	13,012	8,193	6
ECSD #3 / WSSD #12	-	-	-	6,249	6,249	11

(1) FM #1 included as part of FM #2 due to invalid flow data and flow imbalances.

(2) FM #6 included as part of FM #5 due to invalid flow data and flow imbalances.

(3) Flow data at FM #19 not used due to flow imbalances caused by upstream flow meters.

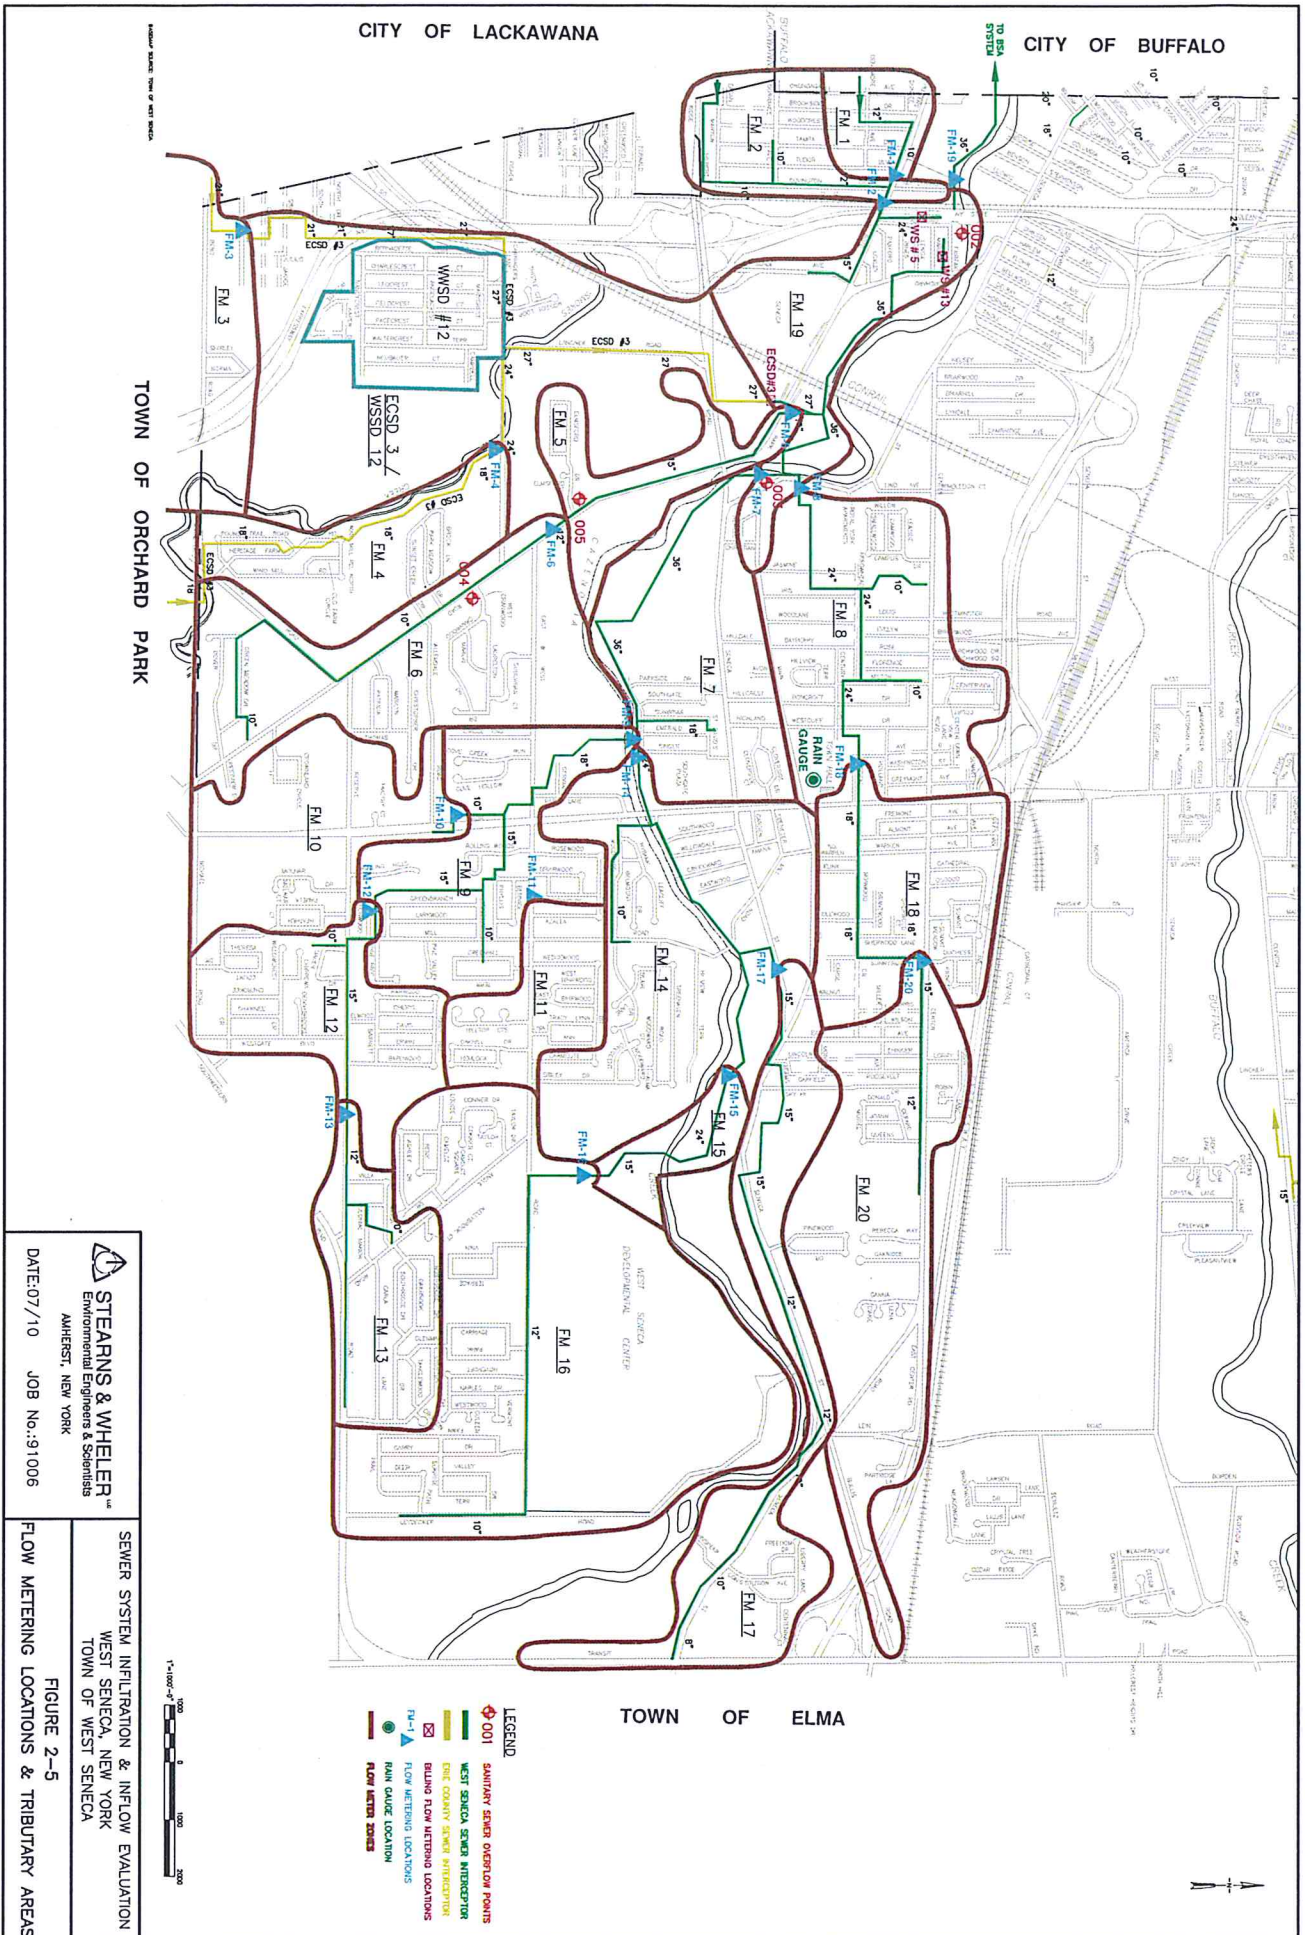


TABLE 4-6

OVERALL PRIORITY RANKING WITH STUDY AND CONTRUCTION PHASING

FLOWMETER NO.	DRY WEATHER I/I RANK	WET WEATHER I/I RANK	INSTANTANEOUS PF RANK	VOLUMETRIC PF RANK	AVERAGE RANK	OVERALL RANK	SANITARY SEWER LENGTH (LF)	PHASE
18	10	2	4	4	5.00	1	60,659	1
10	14	5	1	1	5.25	2	36,590	2
15	1	1	11	11	6.00	3	3,158	1
20	13	6	3	3	6.25	4	61,256	3
3	7	4	8	9	7.00	5	0	-
11	15	7	2	5	7.25	6	31,431	2
8	12	12	5	2	7.75	7	71,032	4
2	2	3	14	13	8.00	8	35,622	5
5	16	9	7	6	9.50	9	85,589	6
17	4	13	9	12	9.50	10	44,842	5
ECSD #3 / WSSD #12	18	11	6	7	10.50	11	52,226	-
13	8	8	13	16	11.25	12	37,811	7
7	5	10	16	15	11.50	13	43,857	7
19	3	-	18	14	11.67	14	32,976	8
14	17	14	10	8	12.25	15	63,259	8
9	6	15	12	17	12.50	16	59,237	9
4	9	16	15	18	14.50	17	0	-
12	19	17	17	10	15.75	18	36,362	9
16	11	18	19	19	16.75	19	90,739	10
1 ⁽¹⁾	20	19	20	20	19.75	20	0	-
6 ⁽²⁾	21	20	21	21	20.75	21	0	-

(1) FM #1 included as part of FM #2 due to invalid flow data and flow imbalances.

(2) FM #6 included as part of FM #5 due to invalid flow data and flow imbalances.